



# US32-NX

**Standard (Gas/Electric/Oil)  
up to 2Heat / 2Cool**

**Heat Pump (Standard and Dual Fuel)  
up to 3Heat / 2Cool**

**Advanced Remote Bus with up to  
11 Remote Sensors**

**Integrated Net/X™ XBus Communications**

## GENERAL DESCRIPTION:

The US32-NX is a communicating setback thermostat designed for new and replacement commercial or residential applications. The US32-NX has a beautiful new blue backlight and secondary display for the remote sensor bus, and is a direct replacement for the GE22-NX and the HP32-NX products. The thermostat can be configured to control conventional HVAC equipment or heat pump equipment with both traditional and dual fuel heat pumps. The unit will operate either as a stand-alone or communicating thermostat.

Using any Net/X™ network controller and the Net/X™ Command Center software, Net/X™ makes it simple with near effortless changes to each setting on the thermostat. The pushbuttons on the thermostat can be locked to give restricted override capabilities, and the optional Occupancy Sensor enables automatic energy savings. The advanced remote sensor bus allows up to 6 indoor remote sensors, humidity sensor, outdoor sensor, and up to 3 auxiliary sensors for needs such as supply air, return air, water temperature, walk-in freezers and refrigerators, and any other temperature monitoring desired.

## STANDARD FEATURES:


*Free PC Software for Controlling Multiple Thermostats from a Single Screen*

- Automatic Changeover from Heat-to-Cool and Cool-to-Heat
- Fan Selector for Automatic or Continuous Fan Operation
- 2 Occupied (Day-Cool & Day-Heat) and 2 Unoccupied (Night-Cool & Night-Heat) Setpoints
- Commercial Lockout Mode with adjustable 0 to 24 Hour Override in 10min Increments
- Resume Button for Cancelling Commercial Override
- +/- 3°F (1°C) or +/- 5°F (2°C) Restricted Temperature Adjustment in Commercial Lockout Mode
- Selectable Fahrenheit or Celsius Display
- Lockable Access Cover
- HVAC equipment control using dry contact relays
- LED1 (Green - Filter) and LED2 (Yellow – Fault) with or without LCD icon indications
- LED3 (Red - Emergency Heat; HP Operation Only)
- Optional Occupancy Sensors Available (Ceiling and Wall Mount)
- Two Digital Inputs (LED1 and LED2) (think Condensate & Fault)
- Occupancy Sensor Input (can also be used as a Occupied/Unoccupied trigger)
- Advanced Remote Sensor Bus (NT-TEMP and NT-HUM) allow up to 6 Indoor, plus Outdoor, Humidity, Aux1, Aux2, Aux3 (think supply air, return air... all on a 3-wire bus)
- Random Restart on power up randomly staggers restart of HVAC system after a power outage to minimize peak in-rush current for a facility

## SPECIFICATIONS:

<b>Rated Voltage:</b>	20V to 30VAC, 24VAC nominal
<b>Rated A.C. / D.C. Current:</b>	0.05 to 0.75 AC / 0.0 to 0.75 DC Amp continuous, per output, surges to 3 Amps max.
<b>Control Range:</b>	<b>Heating:</b> 38 to 88°F (6 to 30°C) in 1° steps <b>Cooling:</b> 60 to 108°F (16 to 40°C) in 1° steps
<b>Thermostat Sensing Range:</b>	20 to 124°F (0 to 48°C) <b>Control Accuracy:</b> +/-1°F @ 68°F (0.5°C @ 20°C)
<b>Minimum Deadband:</b>	(between Heat and Cool) 2°F (1°C)
<b>Dimensions:</b>	4.5"H x 4"W x 1"D (114mm x 102mm x 26mm)
<b>Thermostat LEDs:</b>	Red – Emergency Heat, Yellow – Fault, Green – Filter
<b>Equipment Terminations:</b>	R - 24V switching voltage, W1 - Heat1 or Aux/Emer Heat, G - Fan, Y1-Compressor1, Y2 - Compressor2, O/W2 - Heat2 or Rev. Valve in Cooling, B-Rev. Valve in Heating
<b>Power Terminations:</b>	24V - remote power by removing jumper, 24V(c) - power common (from HVAC equipment)
<b>Input Terminations:</b>	LED1 (Green LED / Filter Icon), LED2 (Yellow LED / Fault Icon)
<b>Occupancy Terminations:</b>	CLK1 (+), CLK2 (-)
<b>Remote Sensor Terminations:</b>	RS+V - Power, RS2 - Return, RS1 - Data

## WIRING DIAGRAMS:

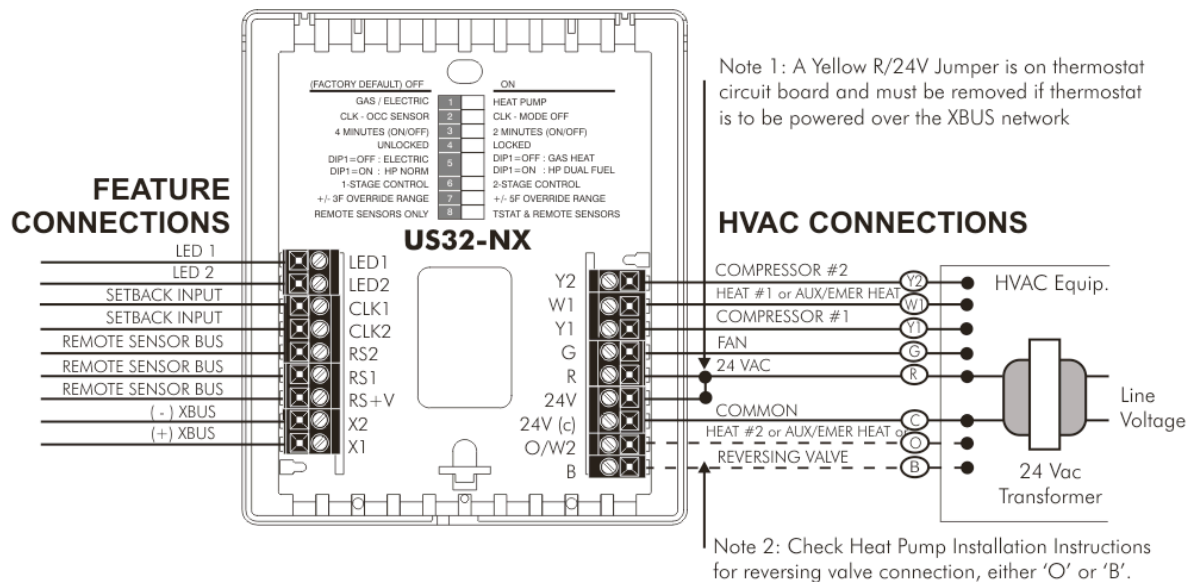

## OUTPUT TERMINAL FUNCTIONS

<b>LED1</b> Free light for status or function indication	<b>Y2</b> Energizes compressor for second stage cooling, or for heat pumps, either second stage heating or cooling
<b>LED2</b> Free light for status or function indication	<b>W1</b> Energizes heater for first stage heating, or for heat pumps, aux/emmer heat
<b>CLK1</b> Dry contact closure input for setback	<b>Y1</b> Energizes compressor for first stage cooling, or for heat pumps, either first stage heating or cooling
<b>CLK2</b> Dry contact closure input for setback	<b>G</b> Energizes fan circuit with a call for heating or cooling
<b>RS2</b> Remote indoor, outdoor and/or wet	<b>R</b> Independent Switching Voltage from HVAC equip
<b>RS1</b> location sensor	<b>24V</b> 24Vac
<b>RS+V</b> Power for remote sensors	<b>24V(c)</b> 24Vac Common
<b>X2</b> Communications bus input/output	<b>O/W2</b> Energizes heater for second stage heating, or for heat pumps, energizes the reversing valve in cooling mode
<b>X1</b> Communications bus input/output	<b>B</b> Energizes the reversing valve in heating mode

## THERMOSTAT DIP SWITCH SELECTIONS

(FACTORY DEFAULT) OFF	ON
GAS / ELECTRIC	HEAT PUMP
CLK - OCC SENSOR	CLK - MODE OFF
4 MINUTES (ON/OFF)	2 MINUTES (ON/OFF)
UNLOCKED	LOCKED
DIP1=OFF : ELECTRIC	DIP1=OFF : GAS HEAT
DIP1=ON : HP NORM	DIP1=ON : HP DUAL FUEL
1-STAGE CONTROL	2-STAGE CONTROL
+/- 3F OVERRIDE RANGE	+/- 5F OVERRIDE RANGE
REMOTE SENSORS ONLY	TSTAT & REMOTE SENSORS